


THE PORT AUTHORITY  
OF NY & NJ









DESIGNED BY: 2/3/83

CONFORMED

Ram Communications  
Consultants, Inc.  
10 Woodbridge Center Drive  
Woodbridge, NJ 07095  
Tel: (908) 755 4445  
Fax: (908) 755 4448

XENON CO.  
CONSULTING ENGINEERS -  
Suite 815, 125 Park Avenue  
Plainfield, New Jersey, 07060  
Tel: (908) 755 4445  
Fax: (908) 755 4448

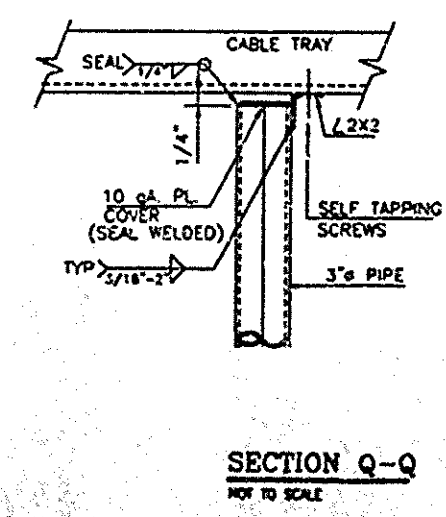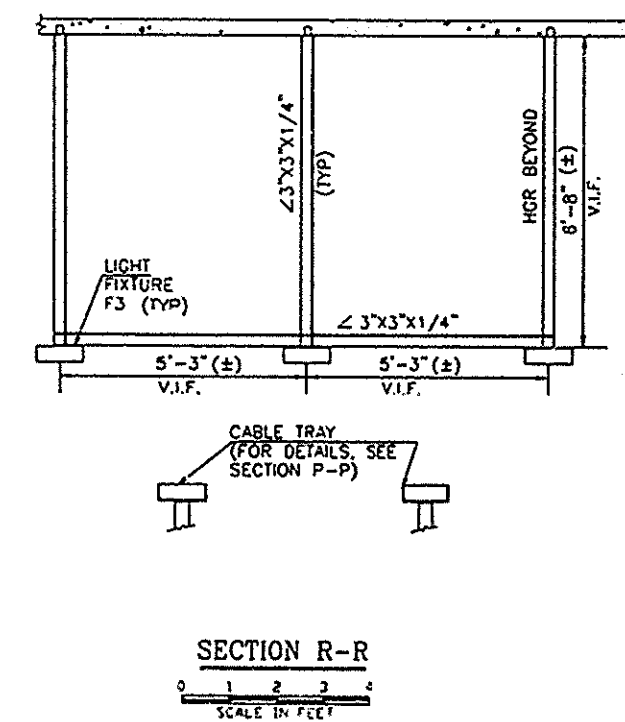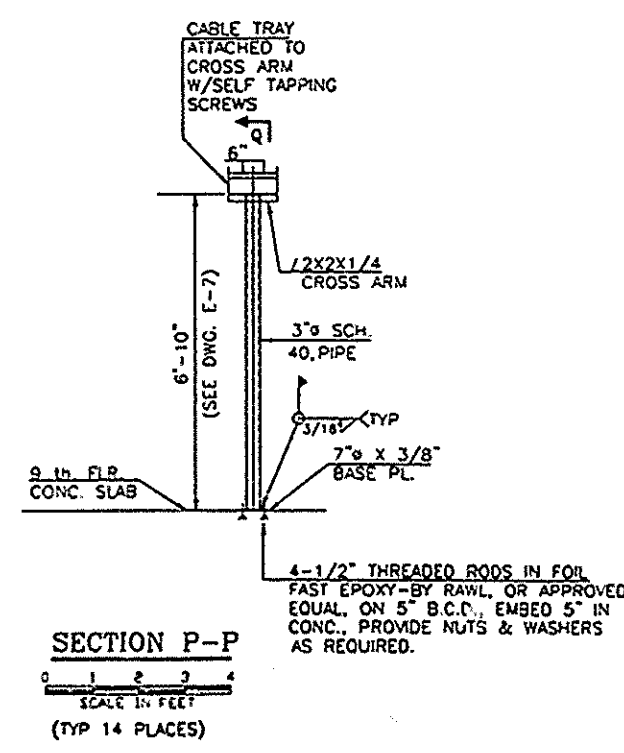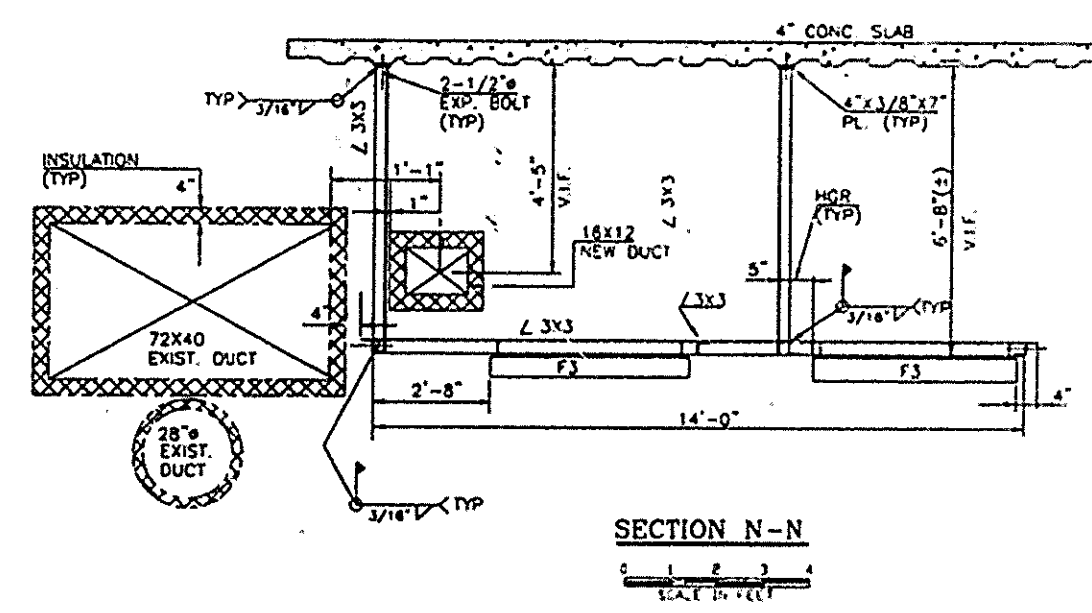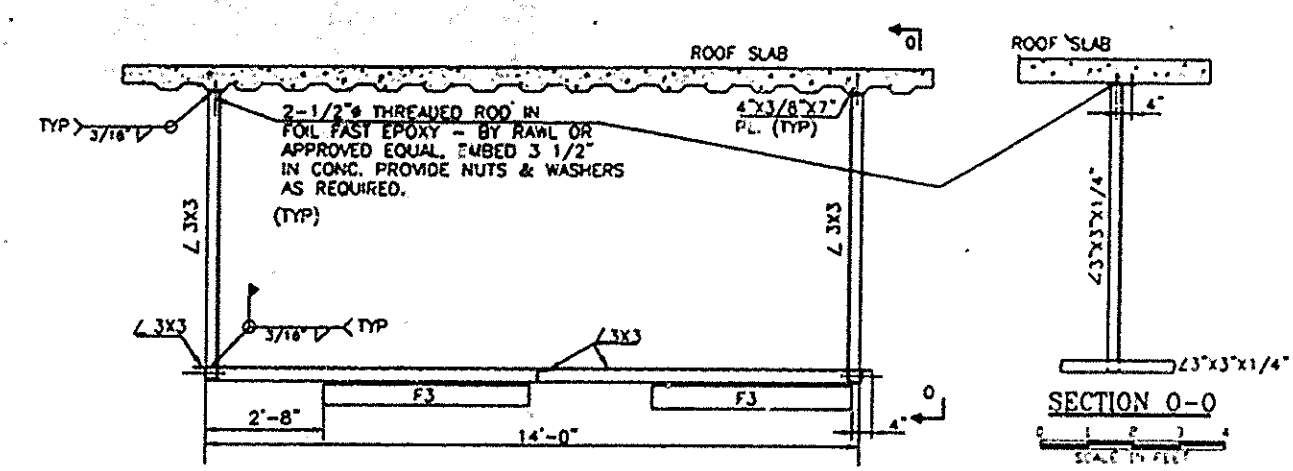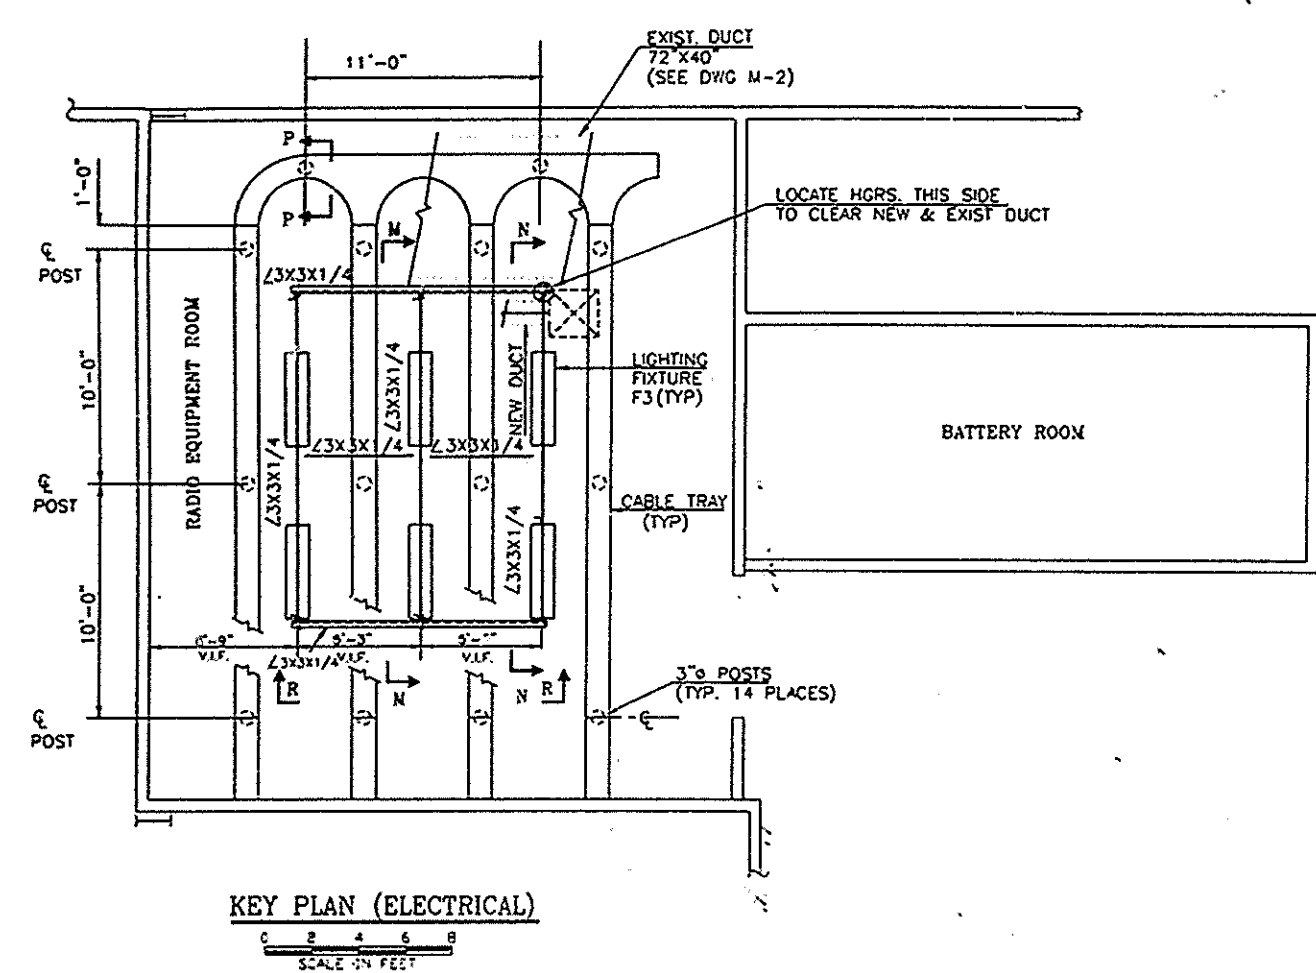

GENERAL NOTES

1. HANGERS, BRACINGS & POSTS SHOWN ARE FOR SEISMIC SUPPORT AT INDICATED LOCATIONS.
2. FOR LOCATIONS OF SEISMIC BRACING ON MECHANICAL EQUIPMENT & DUCTWORK, SEE DWG. S-803.
3. ALL STRUCTURAL STEEL & CONNECTIONS SHOWN IN THIS DWG. SHALL CONFORM TO STEEL NOTES AS STATED ON DWG. S-801.
4. FOR ALL OTHER STEEL NOTES, SEE DWG. S-801.
5. DO NOT CUT REBARS WHILE DRILLING CONCRETE.

The  
World  
Trade  
Center

STANDBY POWER  
5 WORLD TRADE CENTER

COMMUNICATIONS

SEISMIC BRACINGS  
FOR ELECTRICAL CABLE  
TRAYS & LIGHTING  
FIXTURES

This drawing is subject to conditions in contract. All dimensions, notes, details and materials herein are reserved to Port Authority and may not be used without its written consent.

Designed by: SC  
Checked by: AS  
Date: Scale AS NOTED  
Contract Number: WTC-945.071  
Drawing Number: S-804